



NOZZLE SCHEDULE						
ITEM	SIZE	RATING	TYPE	MATL	REMARKS	NOTES
A	20"	UL	MW	C.S.	SINGLE PUNCHED	TIGHT BOLTED
B	8"	NPT	CPL.	C.S.	PRIMARY	EMERGENCY VENT OPENING
C	8"	NPT	CPL.	C.S.	SECONDARY	EMERGENCY VENT OPENING
D	2"	NPT	M.F.	C.S.	-	MONITORING PORT
E	3"	NPT	W.F.	C.S.	-	ATMOSPHERIC VENT OPENING
F	2"	NPT	W.F.	C.S.	-	-
G	4"	NPT	W.F.	C.S.	-	-
H	6"	NPT	H.CPL.	C.S.	-	-

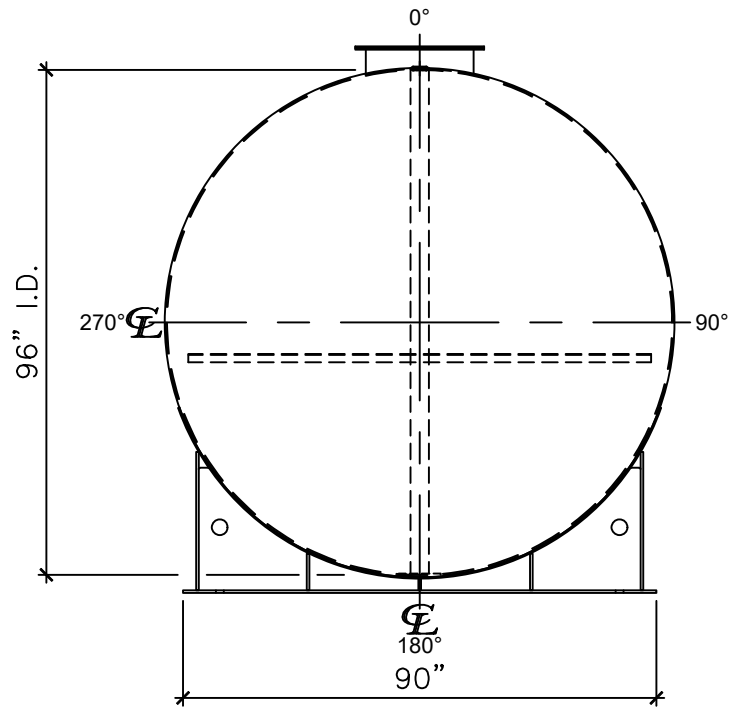

LEFT SIDE

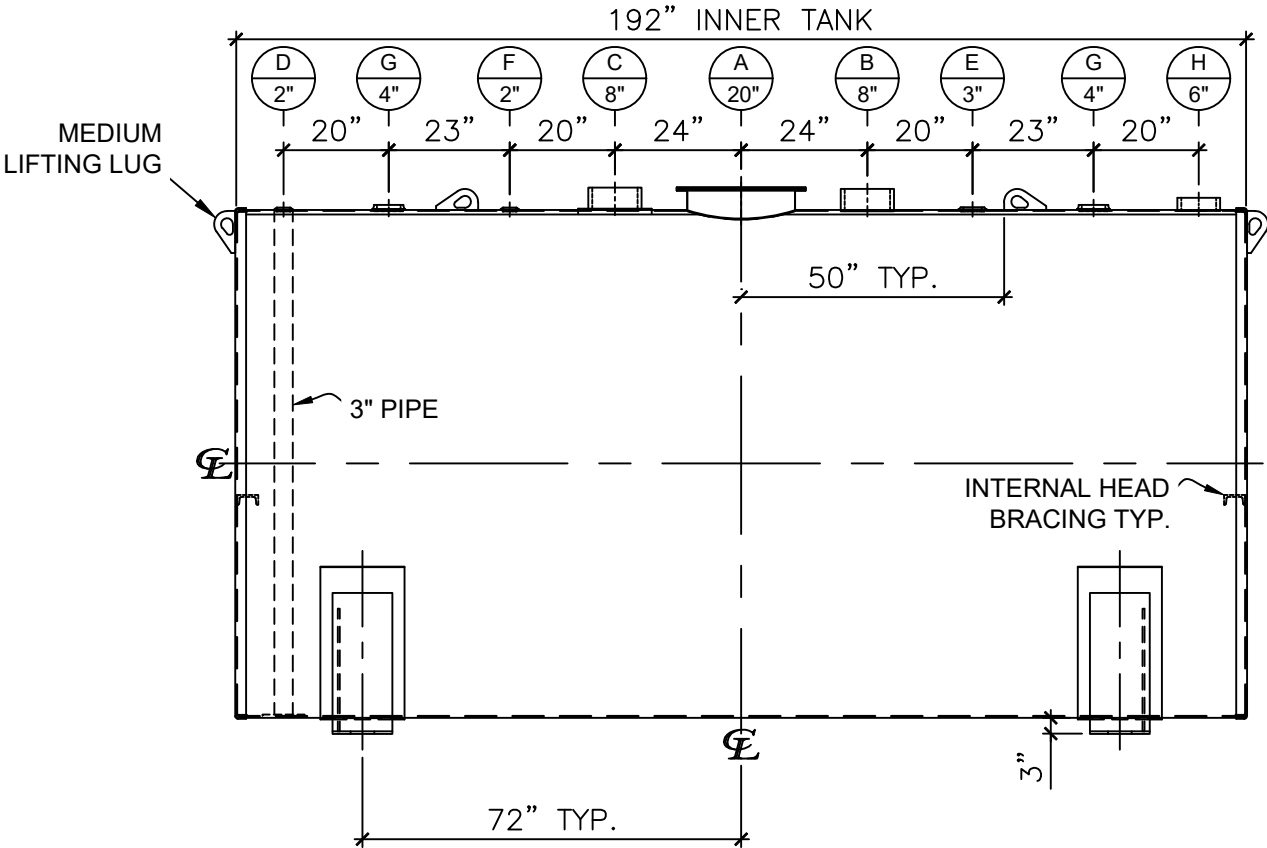

FRONT VIEW

- NOTES:
- A. Material: H.R. Carbon Steel.
 - B. Design Pressure: Atmospheric.
 - C. Design Temperature: Ambient.
 - D. Built & Labeled per UL 142.
 - E. Exterior: Gray primer included; see Sales Order for top coat.
 - F. All Fittings to be protected for shipment.
 - G. Customer to verify Nozzle sizes, locations, and quantities.
 - H. Saddles/Skids may require shimming or grouting during installation.

APPROVAL FOR CONSTRUCTION SCHEDULE A - MASTER TERMS & CONDITION OF SALE*		SALES ORDER:		WEIGHT (LBS): 10,120	
☐ APPROVED AS DRAWN.		Newberry Tanks New Thinking			
☐ APPROVED WITH NOTED CHANGES. CONSTRUCTION WILL BE SCHEDULED WHEN SIGNED DRAWING AND CONFIRMED ORDER ARE RECEIVED.		PHONE: 870-735-4473			
SIGNATURE: _____		DESCRIPTION: 6,000 GALLON 96" I.D. x 16'-0" O.A.L. DOUBLE WALL SADDLE TANK			
DATE: _____		CUSTOMER: _____		P.O.#: _____	
*All pages of this Schedule A are incorporated by reference and are a part of the additional terms of the Master Terms & Conditions of Sale. www.newberrytanks.com/masterterms.pdf		DATE: 08/26/26	REV: 001	DWG # NB06000DWB096	DRAWN BY: WR SHEET 1 OF 1