


| NOZZLE SCHEDULE |      |        |        |      |                |                          |
|-----------------|------|--------|--------|------|----------------|--------------------------|
| ITEM            | SIZE | RATING | TYPE   | MATL | REMARKS        | NOTES                    |
| A               | 20"  | UL     | MW     | C.S. | SINGLE PUNCHED | TIGHT BOLTED             |
| B               | 8"   | NPT    | CPL.   | C.S. | PRIMARY        | EMERGENCY VENT OPENING   |
| C               | 8"   | NPT    | CPL.   | C.S. | SECONDARY      | EMERGENCY VENT OPENING   |
| D               | 2"   | NPT    | M.F.   | C.S. | -              | MONITORING PORT          |
| E               | 3"   | NPT    | W.F.   | C.S. | -              | ATMOSPHERIC VENT OPENING |
| F               | 4"   | NPT    | W.F.   | C.S. | -              | -                        |
| G               | 6"   | NPT    | H.CPL. | C.S. | -              | -                        |
| H               | 2"   | NPT    | W.F.   | C.S. | -              | -                        |

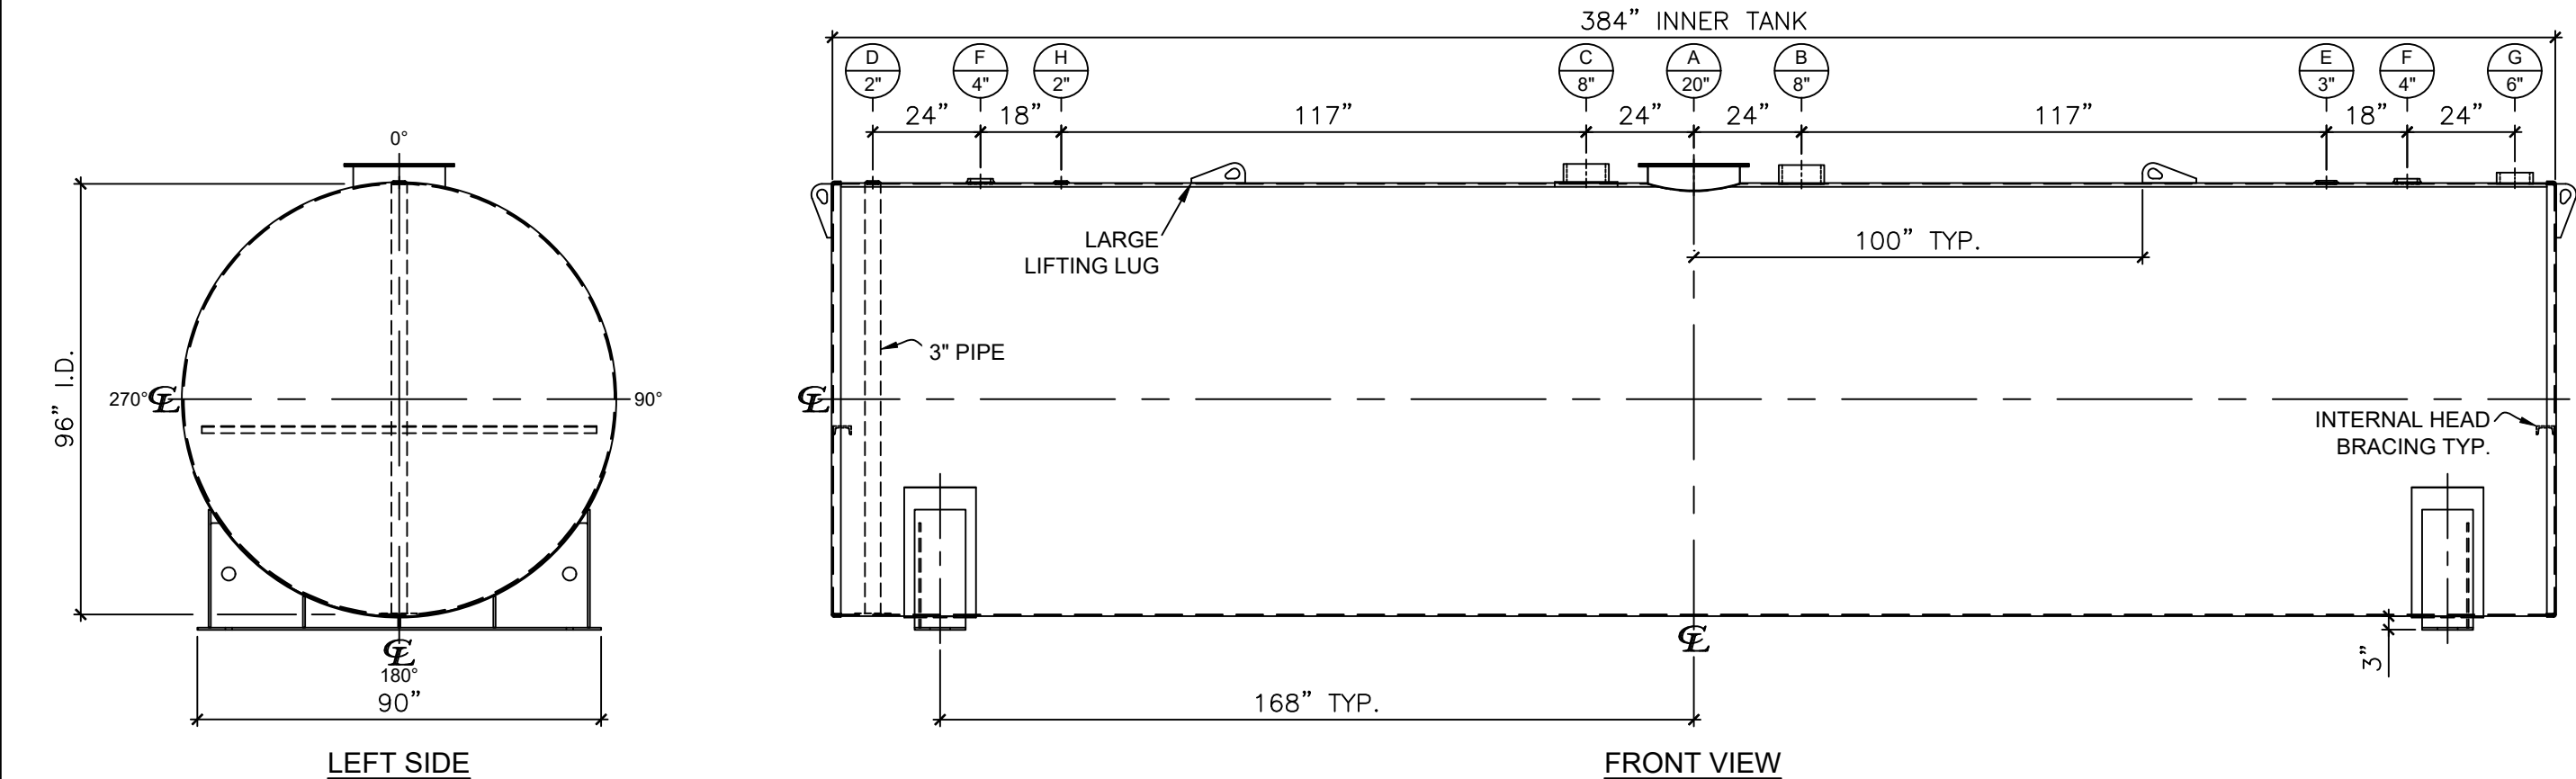

- NOTES:
- A. Material: H.R. Carbon Steel.
  - B. Design Pressure: Atmospheric.
  - C. Design Temperature: Ambient.
  - D. Built & Labeled per UL 142.
  - E. Exterior: Gray primer included; see Sales Order for top coat.
  - F. All Fittings to be protected for shipment.
  - G. Customer to verify Nozzle sizes, locations, and quantities.
  - H. Saddles/Skids may require shimming or grouting during installation.

APPROVAL FOR CONSTRUCTION  
SCHEDULE A - MASTER TERMS &  
CONDITION OF SALE\*

☐ APPROVED AS DRAWN.

☐ APPROVED WITH NOTED CHANGES.  
CONSTRUCTION WILL BE SCHEDULED  
WHEN SIGNED DRAWING AND  
CONFIRMED ORDER ARE RECEIVED.

SIGNATURE: \_\_\_\_\_

DATE: \_\_\_\_\_

\*All pages of this Schedule A are incorporated by  
reference and are a part of the additional terms of  
the Master Terms & Conditions of Sale.  
www.newberrytanks.com/masterterms.pdf

SALES ORDER:

Newberry Tanks  
New Thinking

PHONE: 870-735-4473

DESCRIPTION:  
12,000 GALLON 96" I.D. x 32'-0" O.A.L.  
DOUBLE WALL SADDLE TANK

CUSTOMER: \_\_\_\_\_

P.O.#: \_\_\_\_\_

DATE: 08/25/26

REV: 001

DWG# NB12000DWB096

DRAWN BY: WR

WEIGHT (LBS): 17,500

ALL UNITS INCHES  
UNLESS STATED  
OTHERWISE

SHEET 1 OF 1