



NOZZLE SCHEDULE								
ITEM	SIZE	RATING	TYPE	MATL.	PROJ. IN	PROJ. OUT	REMARKS	NOTES
A	20"	UL	MW	C.S.	STD.	STD.	SINGLE PUNCHED	TIGHT BOLTED
B	8"	NPT	CPL.	C.S.	STD.	STD.	PRIMARY	EMERGENCY VENT OPENING
C	8"	NPT	CPL.	C.S.	STD.	STD.	SECONDARY	EMERGENCY VENT OPENING
D	4"	NPT	W.F.	C.S.	STD.	STD.	-	INTERSTICE FILL
E	2"	NPT	PIPE	C.S.	STD.	STD.	-	MONITORING PORT
F	3"	NPT	CPL.	C.S.	STD.	STD.	-	ATMOSPHERIC VENT OPENING
G	2"	NPT	CPL.	C.S.	STD.	STD.	-	-
H	4"	NPT	CPL.	C.S.	STD.	STD.	-	-
J	6"	NPT	CPL.	C.S.	STD.	STD.	-	-

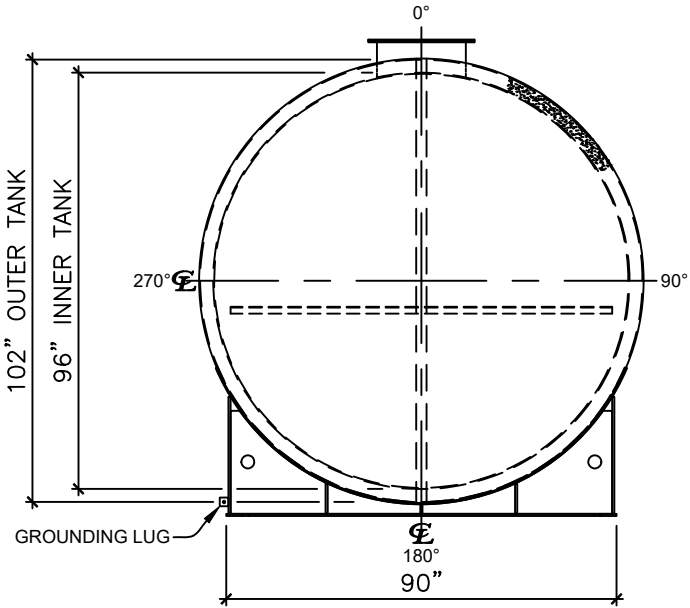

LEFT SIDE

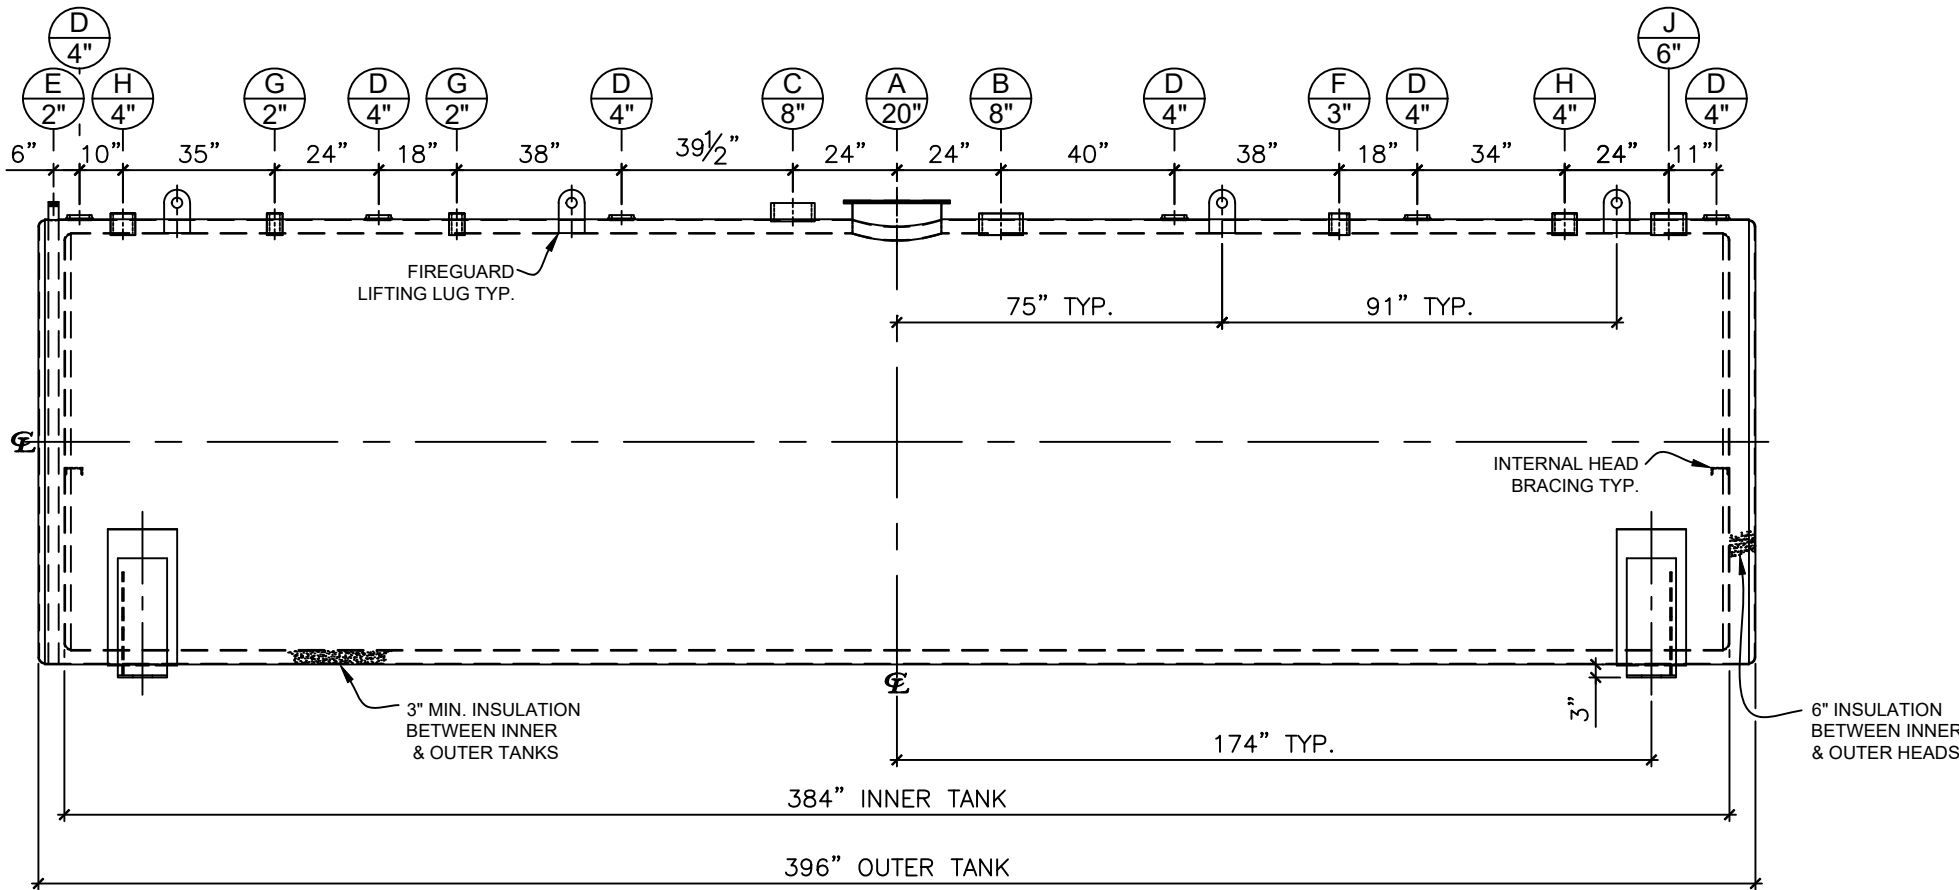

FRONT VIEW

- NOTES:
- A. Material: H.R. Carbon Steel.
 - B. Design Pressure: Atmospheric.
 - C. Design Temperature: Ambient.
 - D. Built & Labeled per UL 142, 2085 & STI Fireguard Specifications.
 - E. Interstice to be filled w/ 3" MIN. thermal insulation.
 - F. Exterior: Blast & Apply one shop coat WHITE enamel.
 - G. All Fittings to be labeled and protected for shipment.
 - H. Customer to verify Nozzle sizes, locations, and quantities.
 - I. Saddles/Skids may require shimming or grouting during installation.

APPROVAL FOR CONSTRUCTION SCHEDULE A - MASTER TERMS & CONDITION OF SALE*		SALES ORDER:		WEIGHT (LBS): 33,422	
☐ APPROVED AS DRAWN.					
☐ APPROVED WITH NOTED CHANGES. CONSTRUCTION WILL BE SCHEDULED WHEN SIGNED DRAWING AND CONFIRMED ORDER ARE RECEIVED.		PHONE: 870-735-4473			
SIGNATURE: _____		DESCRIPTION: 12,000 GALLON 96" I.D. x 32'-0" O.A.L. FIREGUARD SADDLE TANK			
DATE: _____		CUSTOMER: -		P.O.# -	
*All pages of this Schedule A are incorporated by reference and are a part of the additional terms of the Master Terms & Conditions of Sale. www.newberrytanks.com/masterterms.pdf		DATE: 06/19/26		REV: 001	
		DWG.# NB12000FGD096		DRAWN BY: WR	
				SHEET 1 OF 1	